
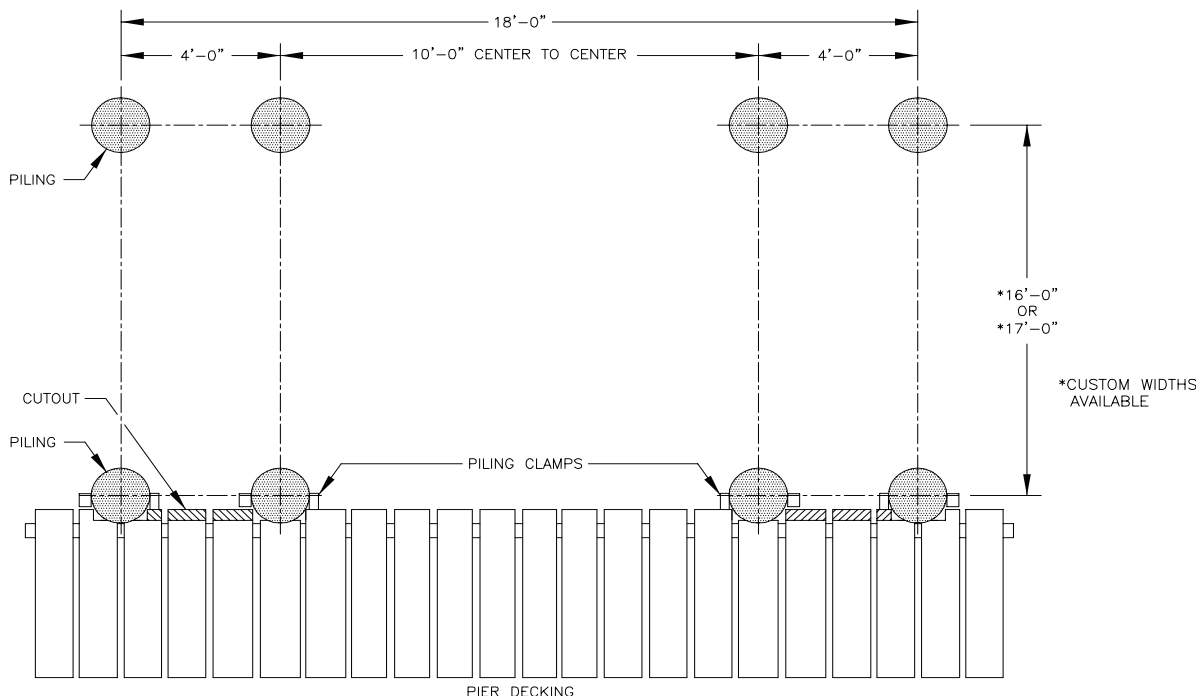


PILING PLACEMENT MEASUREMENTS ARE CENTER TO CENTER

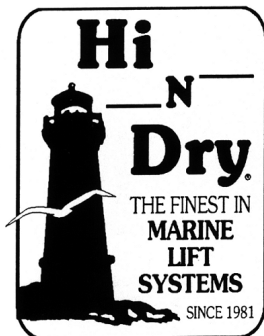

HIGH-N-DRY 25K / 30K / 40K GENERAL SPECS

	25,000 lb.	30,000 lb.	40,000 lb.
Number of Pilings	8 ea. 10" - 12" dia	8 ea. 10" - 12" dia.	8 ea. 10" - 12" dia.
Height of Pilings	4'	4'	4'
Power Requirements	220 volts, 40 amps	220 volts, 40 amps	220 volts, 40 amps
Motor Specs	4 - 1 HP 1750 RPM	4 - 1 HP 1750 RPM	4 - 1 ½ hp 1750 RPM
Switching Gear	Wireless Remote Control with Auto Shut-off	Wireless Remote Control with Auto shut-off	Wireless Remote Control with Auto shut-off
Cable Size	7x19 Stainless Steel 5/16 diameter 45'	7x19 Stainless Steel 3/8 diameter 45'	7x19 Stainless Steel 3/8 diameter 45'
Cradle Beams	2ea. 10x4 class 50 19 lb. per foot	2 ea. 10x5 class 50 26 lb. per foot	2 ea. 12x5 class 50 35 lb. per foot
Bunks	2ea. 8" I Beam Reinforced 4x6x16' Timbers	2 ea. 8" I Beam Reinforced 4x6x16' Timbers	2 ea. 8" I Beam Reinforced 4x6x16' Timbers
Drive Units	AMS 4000 E-Gear AMS E-Gear Direct Drive	AMS 5000 E-Gear AMS E-Gear Direct Drive	AMS 5000 E-Gear AMS E-Gear Direct Drive
Power Beams	4 ea. 5"H. x 10"W x 5'L	4 ea. 5"H x 10"W x 5'L	4 ea. 5"H x 10"W x 5'L
Bearings	8 ea. Pillow Block	8 ea. Pillow Block	8 ea. Pillow Block
Drum Size	2" x 7/16 dia.	2" x 7/16 dia.	2" x 7/16 dia.